




VÅR VISJON

vi streber alltid etter det aller beste vann

The principle for sampling

1. Take one sample in Tap for sampling
2. Turn off UV-light, then wait 10 minutes, then tap water 2 minute then take one sample in Tap for sampling.
3. Attach DabV to the tube, then wait for 10 minutes, then tap water 2 minute then take one sample in Tap for sampling.

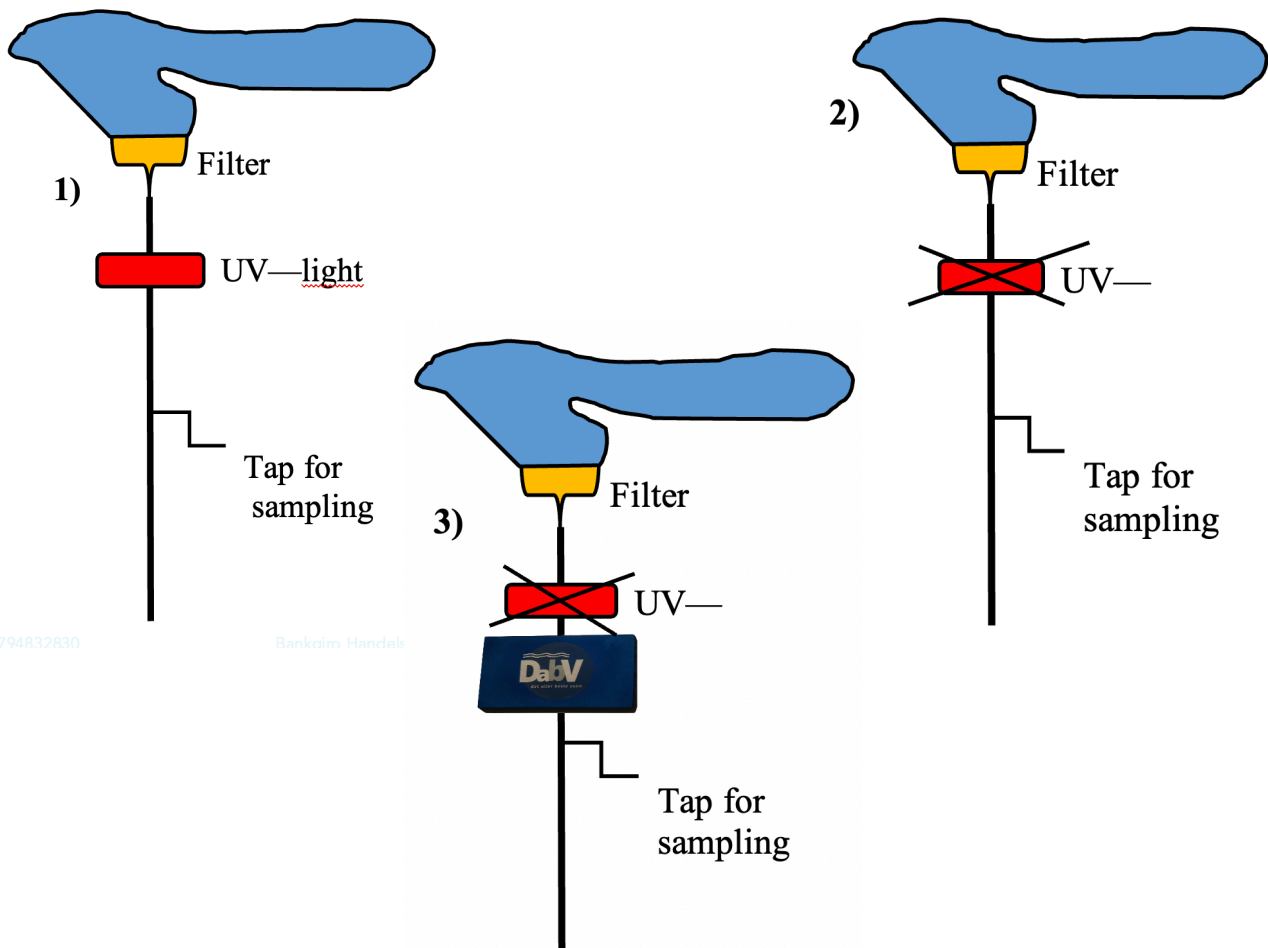

4794832830

Bankgiro Handelk



VÅR VISJON

vi streber alltid etter det aller beste vann

Results of the analysis

Ref.number in paint:	1)	2)	3)
BACTERIOLOGICAL ANALYSIS			
Total Coliforms (cfu/100 ml TC)	15	2410	ND
E. Coli (cfu/100 ml E.C)	13	2394	ND
OTHER MICROBIOLOGY TESTS			
Enterococci (cfu/100 ml ISO 7899-2)	7	2898	ND

Notes and Disclaimer

18. des.21

FAIL

PASS

Results of the analysis in Kenya

ISO 17025:2005 COMPANY



LABORATORY TEST REPORT

AQUALYTIC LABORATORIES LIMITED
 P.O Box 4600 - 00506 Nairobi
 Winsford Park
 Off Baba Dogo Road
 Email: lab@aqualyticlab.com
 Website: www.aqualyticlab.com
 Tel: (020) 5249675 Cell: 0722 54 73 44

DECEMBER 18TH, 2021

1

Description of Sample: TREATED POTABLE WATER
 Sample Source: NAIROBI
 Submitted By: J.M MATHENGE
 Customer Contact: TILLIT INVESTMENT CO.LTD
 Sampled By: CLIENT

Date of Sampling: 14/12/2021
 Date Sample Received: 14/12/2021
 Date of Analysis: 16/12/2021
 Date of Report Issue: 18/12/2021
 Sample ID: S0513-19350

PARAMETERS	METHOD	VALUES	KS EAS 12:2018 TREATED	WHO STANDARD	REMARKS
BACTERIOLOGICAL ANALYSIS					
Total Coliforms (cfu/100 ml TC)	KS ISO 9308-1:2014	15	ND	ND	FAIL
E. Coli (cfu/100 ml E.C)	KS ISO 9308-1:2014	13	ND	ND	FAIL
OTHER MICROBIOLOGY TESTS					
Enterococci (cfu/100 ml ISO 7899-2)	ISO 7899-2	7	NS	-	-

Notes and Disclaimer

KS EAS 153:2018 - Packaged Drinking Water —Specification, KS EAS 12:2018 - Potable Water —Specification, ANSI/AAMI/ISO 23500-3:2019 - Preparation and quality management of fluids for haemodialysis and related therapies—Part 3: Water for haemodialysis and related therapies, EMCR 2006 -Environmental Management and Co-ordination (Water Quality) Regulations 2006, WHO 4th EDITION - World Health Organization Guidelines for Drinking - Water Quality. ISE - Ion Selective Electrode, NS - No Set Standard, ND - Not Detected, Parameters marked with (*) are Subcontracted while ✓ are Accredited.

The test report shall not be reproduced except in full without written approval from Aqualytic Laboratories Limited.

Det Aller Beste Vann As
 Austre Vardane 5B
 5306 ERDAL

+4794832830
 post@detallerbestevann.com
 https://detallerbestevann.com

Bankgiro Handelsbanken
 Konto nr. 9521.36.52738
 Org. nr. 925 665 975 Mva



VÅR VISJON

vi streber alltid etter det aller beste vann



AQUALYTIC LABORATORIES LIMITED
 P.O Box 4600 - 00506 Nairobi
 Winsford Park
 Off Baba Dogo Road
 Email: lab@aqualyticlab.com
 Website: www.aqualyticlab.com
 Tel: (020) 5249675 Cell: 0722 54 73 44

ISO 17025:2005 COMPANY

LABORATORY TEST REPORT

DECEMBER 18TH, 2021

2

Description of Sample:	TREATED POTABLE WATER	Date of Sampling:	14/12/2021
Sample Source:	NAIROBI-TREATED WATER DABV	Date Sample Received:	14/12/2021
Submitted By:	J.M MATHENGE	Date of Analysis:	16/12/2021
Customer Contact:	TILLIT INVESTMENT CO.LTD	Date of Report Issue:	18/12/2021
Sampled By:	CLIENT	Sample ID:	S0513-19352

PARAMETERS	METHOD	VALUES	KS EAS 12:2018 TREATED	WHO STANDARD	REMARKS
BACTERIOLOGICAL ANALYSIS					
Total Coliforms (cfu/100 ml TC)	KS ISO 9308-1:2014	2410	ND	ND	FAIL
E. Coli (cfu/100 ml E.C)	KS ISO 9308-1:2014	2394	ND	ND	FAIL
OTHER MICROBIOLOGY TESTS					
Enterococci (cfu/100 ml ISO 7899-2)	ISO 7899-2	2898	NS	-	-

Notes and Disclaimer

KS EAS 153:2018 - Packaged Drinking Water —Specification, KS EAS 12:2018 - Potable Water —Specification, ANSI/AAMI/ISO 23500-3:2019 - Preparation and quality management of fluids for haemodialysis and related therapies—Part 3: Water for haemodialysis and related therapies, EMCR 2006 -Environmental Management and Co-ordination (Water Quality) Regulations 2006, WHO 4th EDITION - World Health Organization Guidelines for Drinking - Water Quality. ISE - Ion Selective Electrode, NS - No Set Standard, ND - Not Detected, Parameters marked with (*) are Subcontracted while ✓ are Accredited.

The test report shall not be reproduced except in full without written approval from Aqualytic Laboratories Limited.
 The laboratory will not be held responsible for any sampling error.

COMMENTS

Based on the tested parameters only, the water sample was found not to conform to the Treated Potable Water (KS EAS 12:2018 TREATED)(failed analytes) Total Coliforms, E. Coli does not meet the set standard. Therefore, treatment is recommended.



AQUALYTIC LABORATORIES LIMITED
 P.O Box 4600 - 00506 Nairobi
 Winsford Park
 Off Baba Dogo Road
 Email: lab@aqualyticlab.com
 Website: www.aqualyticlab.com
 Tel: (020) 5249675 Cell: 0722 54 73 44

ISO 17025:2005 COMPANY

LABORATORY TEST REPORT

DECEMBER 18TH, 2021

3

Description of Sample:	TREATED POTABLE WATER	Date of Sampling:	14/12/2021
Sample Source:	NAIROBI-TREATED WATER FILTRATION DABV	Date Sample Received:	14/12/2021
Submitted By:	J.M MATHENGE	Date of Analysis:	16/12/2021
Customer Contact:	TILLIT INVESTMENT CO.LTD	Date of Report Issue:	18/12/2021
Sampled By:	CLIENT	Sample ID:	S0513-19351

PARAMETERS	METHOD	VALUES	KS EAS 12:2018 TREATED	WHO STANDARD	REMARKS
BACTERIOLOGICAL ANALYSIS					
Total Coliforms (cfu/100 ml TC)	KS ISO 9308-1:2014	ND	ND	ND	PASS
E. Coli (cfu/100 ml E.C)	KS ISO 9308-1:2014	ND	ND	ND	PASS
OTHER MICROBIOLOGY TESTS					
Enterococci (cfu/100 ml ISO 7899-2)	ISO 7899-2	ND	NS	-	-

Notes and Disclaimer

KS EAS 153:2018 - Packaged Drinking Water —Specification, KS EAS 12:2018 - Potable Water —Specification, ANSI/AAMI/ISO 23500-3:2019 - Preparation and quality management of fluids for haemodialysis and related therapies—Part 3: Water for haemodialysis and related therapies, EMCR 2006 -Environmental Management and Co-ordination (Water Quality) Regulations 2006, WHO 4th EDITION - World Health Organization Guidelines for Drinking - Water Quality. ISE - Ion Selective Electrode, NS - No Set Standard, ND - Not Detected, Parameters marked with (*) are Subcontracted while ✓ are Accredited.

The test report shall not be reproduced except in full without written approval from Aqualytic Laboratories Limited.
 The laboratory will not be held responsible for any sampling error.

COMMENTS

Based on the tested parameters only, the water sample was found to conform to the Treated Potable Water (KS EAS 12:2018 TREATED)

Det Aller Beste Vann As
 Austre Vardane 5B
 5306 ERDAL

+4794832830
 post@detallerbestevann.com
 https://detallerbestevann.com

Bankgiro Handelsbanken
 Konto nr. 9521.36.52738
 Org. nr. 925 665 975 Mva